


CORPORATION STOP SERVICE CONNECTION

NOT TO SCALE

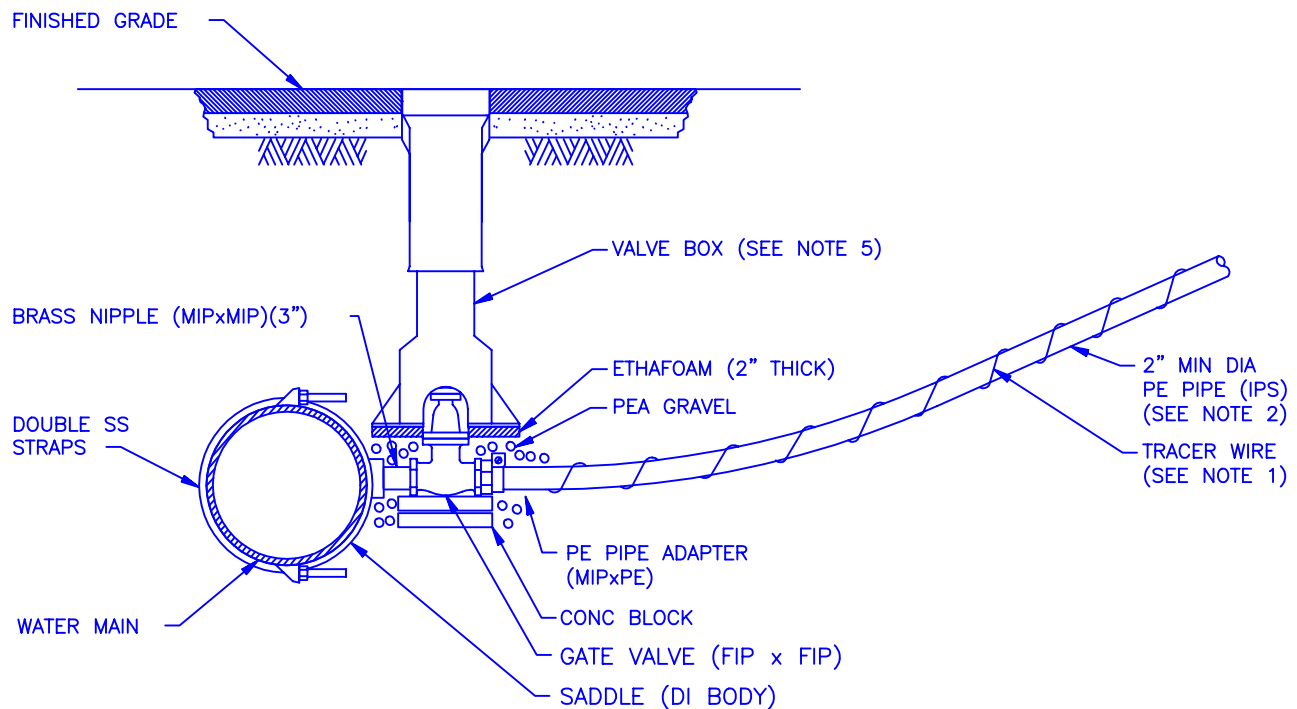

GATE VALVE SERVICE CONNECTION

NOT TO SCALE
(SEE NOTE 4)

NOTES:

1. ATTACH 12 GAUGE TRACER WIRE TO WATER MAIN TO MAKE ELECTRICALLY CONTINUOUS.
2. SEE CONSTRUCTION DRAWINGS FOR SERVICE CONNECTION PIPE SIZE.
3. SERVICE PIPE SHALL BE BURIED IN PEA GRAVEL.
4. GATE VALVE SERVICE CONNECTION TO BE USED WITH TRIPLE AND QUADRUPLE MANIFOLDS.
5. VALVE BOX LIDS SHALL BE INSTALLED FLUSH WITH FINISHED GRADE.
6. DIRECT TAPPING OF WATER MAIN IS NOT ALLOWED.

APPROVED: SCOTT THOMASSON

REV. DATE: FEB. 1, 1997

WATER/WASTEWATER DIVISION



STANDARD DETAILS

SERVICE CONNECTIONS

FILE SD701.DWG DRAWING NO. **701**